

JOB:

ITEM#:


### ELECTRICAL REQUIREMENTS

120V, 1 PHASE, 50/60Hz, 15 AMP DEDICATED  
GROUND CIRCUIT

### ELECTRICAL SPECIFICATIONS

UL LISTED POWER SUPPLY WITH SIX FOOT CORD WITH  
3 PRONG GROUNDED PLUG, 120 VAC, 1 PHASE,  
2 AMP, 50/60Hz

## STANDARD 36 BOTTLE LIQUOR RACK

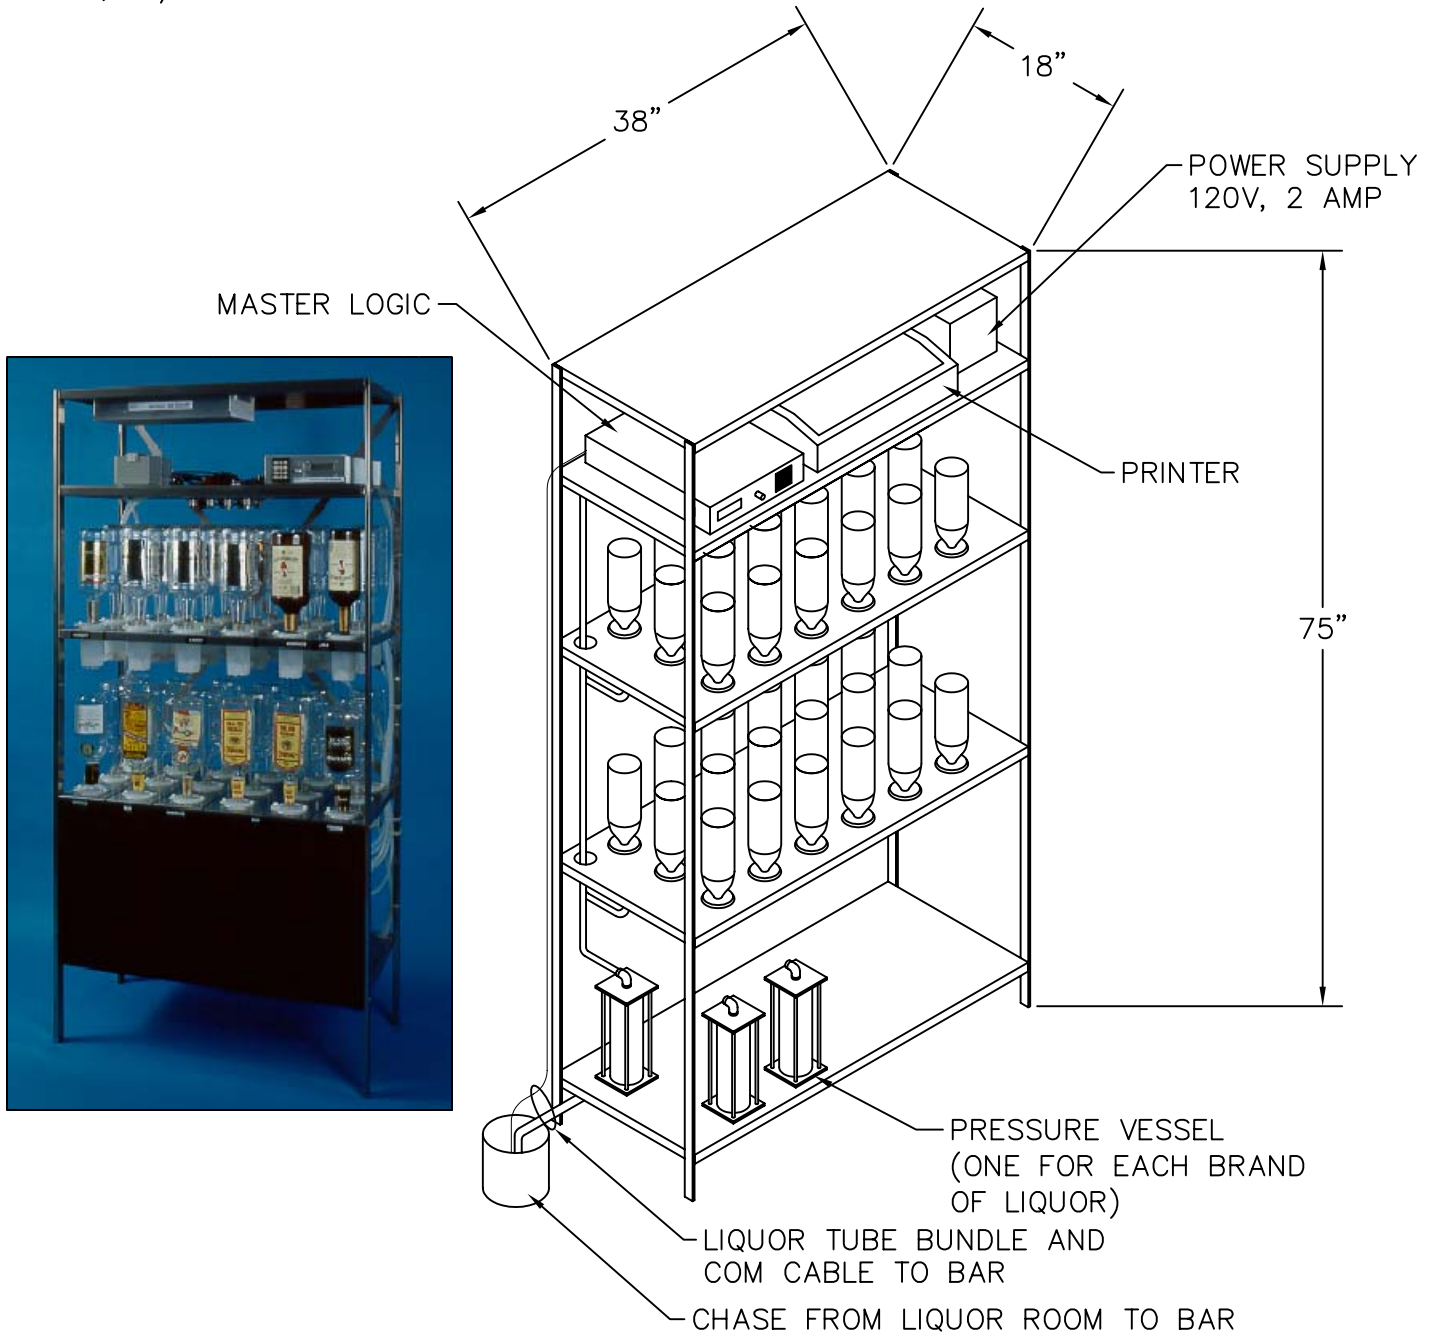

(LOCATED IN LIQUOR ROOM)

**AUTOMATIC BAR CONTROLS, INC.**  
790 EUBANKS DRIVE  
VACAVILLE, CA 95688

**PHONE: (707) 448-5151**  
**FAX : (707) 448-1521**  
**WWW.WUNDERBAR.COM**